



Project Name: _____

Schedule / Date: _____

Notes: _____

ETL No.: Intertek **5014001**

DLC Family Code: **YYF0H**

Improved **Thermal Management**

Flicker Free and Anti-Glare

True **100% OFF 0-10V** Dimming

AUX PIR / DC PnP Microwave **Occupancy**
Controls with **Daylight Sensing**, **Customizable**
Standby and **Bi-Level** Functionality

ETL Certified for Safety

DLC 5.1 Premium Rated for Efficiency

CRI: **83** (Upgraded Color Rendering Index)

Warranty: **5 Years**



ORDERING GUIDE

SERIES	CATEGORY	SIZE	WATTAGE	CCT	SENSOR	VOLTAGE
JL	BPL Back-lit Panel	14 1x4' 22 2x2'	ZZ Tunable 15 15w 20 20w 25 25w 30 30w 40 40w	CCT Tunable 35 3500k 40 4000k 50 5000k 57 5700k 65 6500k	Blank None S Sensor	VL 120-277V VH 120-347V

EXAMPLE: **JL-BPL22-ZZW-CCT-S-VL**

JL	BPL Back-lit Panel	24 2x4'	ZZ Tunable 25 25w 30 30w 35 35w 40 40w 50 50w	CCT Tunable 35 3500k 40 4000k 50 5000k 57 5700k 65 6500k	Blank None S Sensor	VL 120-277V VH 120-347V
----	----------------------	-----------	--	---	----------------------------	--------------------------------

EXAMPLE: **JL-BPL24-ZZW-CCT-S-VL**



Project Name: _____

Schedule / Date: _____

Notes: _____

SPECIFICATIONS

SKU	53-201EM					53-203EM					53-202EM				
MODEL NO.	JL-BPL22-ZZW-CCT-S-[VL,VH]					JL-BPL14-ZZW-CCT-S-[VL,VH]					JL-BPL24-ZZW-CCT-S-[VL,VH]				
Brand	Kinlight					Kinlight					Kinlight				
Size	2' x 2'					1' x 4'					2' x 4'				
Wattage	15w	20w	25w	30w	40w	25w	30w	30w	35w	40w	50w	25w	30w	30w	35w
Efficacy	132.28 LPW					138.08 LPW					3526	4230	4914	5603	6904
Luminous Flux	2098	2800	3480	4160	5291	3526	4230	4914	5603	6904	219mA	263mA	307mA	350mA	438mA
Input @120V	131mA	175mA	219mA	263mA	350mA	219mA	263mA	307mA	350mA	438mA	219mA	263mA	307mA	350mA	438mA
12Vdc Output	Max Current 200mA					Max Current 200mA					Max Current 200mA				
Color Temp.	3500K 4000K 5000K 5700K 6500K					3500K 4000K 5000K 5700K 6500K					3500K 4000K 5000K 5700K 6500K				
Input Voltage	AC120-277V, 50/60Hz					AC120-277V, 50/60Hz					AC120-277V, 50/60Hz				
Dimmable	0-10V (True Off)					0-10V (True Off)					0-10V (True Off)				
CRI	83					83					83				
Beam Angle (°)	110°					110°					110°				
THD	≤20%					≤20%					≤20%				
Flicker	No Flicker					No Flicker					No Flicker				
Power Factor	≥0.9					≥0.9					≥0.9				
IP Rate	IP20 - Indoor					IP20 - Indoor					IP20 - Indoor				
Working Temp.	-20°C ~ +55°C / -4°F ~ +131°F					-20°C ~ +55°C / -4°F ~ +131°F					-20°C ~ +55°C / -4°F ~ +131°F				
Storage Temp.	-40°C ~ +60°C / -40°F ~ +140°F					-40°C ~ +60°C / -40°F ~ +140°F					-40°C ~ +60°C / -40°F ~ +140°F				
Lifespan	50,000h					50,000h					50,000h				
Pcs/Carton	1					1					1				
Package Dims	25.40" x 25.60" x 2.96"					49.40" x 13.78" x 2.96"					49.40" x 25.59" x 2.96"				
Weight	7.74 lbs					8.17 lbs					13.25 lbs				

DLC Number

Size Wattage	2 x 2'	1 x 4'	2 x 4'
15	S-1ND3ST	S-HZSQBW	/
20	S-UXMDVE	S-CFK25J	/
25	S-QV5WEF	S-BKHT6M	S-XDRIJ9
30	S-OKSPQG	S-JM6RF3	S-H4LPQ8
35	/	/	S-YI48U1
40	S-N5B8JO	S-SCMXWU	S-JSOTUG
50	/	/	S-YXAT3K



Project Name: _____

Schedule / Date: _____

Notes: _____

EBB SPECIFICATIONS

SKU	91-8011
Wattage	9W
Input Voltage	100-347Vac,50/60Hz
Output Voltage	150-200Vdc,250V Mac
Battery	Lithium
Recharge Duration	<24 hours
Emergency Duration	90 minutes
Power Factor	0.6@100 Vac,0.5@347 Vac
Max input Current	800 mA max
Output Current	45-60 mA
Battery Capacity	11.1V/1800mAh
Compatible LED Lamp	Max.90W LED Back-Lit Panel
Ambient Temp	0-50°C (32°F -122°F)

EBB FETURES

UL924 listed for field or factory installation,CEC title 20 compliant

Compliance with American NFPA 101 life Safety Code

With built-in junction box.

Monthly/annual self-testing

With multi-protection function:

- Battery overcharge protection
- Battery over-discharge protection
- Output overload protection
- Short-circuit protection
- Open load protection



Project Name: _____

Schedule / Date: _____

Notes: _____

EBB SELF-TEST MODE

Operations	Indicator status	Working status
Self-test Mode	Lights OFF	Monthly testing
	Lights OFF	Annual testing
	Lights ON	Battery is charging or fully charged
Failure Mode	Lights Flashing	1. The battery pack is not connected or it is broken 2. The load is not connected 3. A short circuit may be present 4. The dimming wires are not connected properly

1. Monthly Self-Test

It will automatically perform a monthly self-test every 30 days with a duration of 30S to check whether the emergency function is normal, and automatically restore to normal charging after 30S discharged

2. Annual self-test


An annual self-test will be done every year (12 months) with a duration of more than 90mins to check whether the capacity of the battery pack is normal, and automatically restore to normal charging after fully discharged. (the condition of annual test is that the battery pack is fully charged). If the Annual inspection is interrupted, it will be retested after recovery and when the test conditions are met. (Possibility of interruption: such as sudden power failure, sudden manual test).

EMERGENCY MODE

1. The emergency battery backup enters the emergency mode immediately after the mains power failure, the lamp lights after a delay of three seconds.
2. Stop the Emergency and return to the charging state after the mains power call.

GENERAL WIRING DIAGRAM

With Sensor

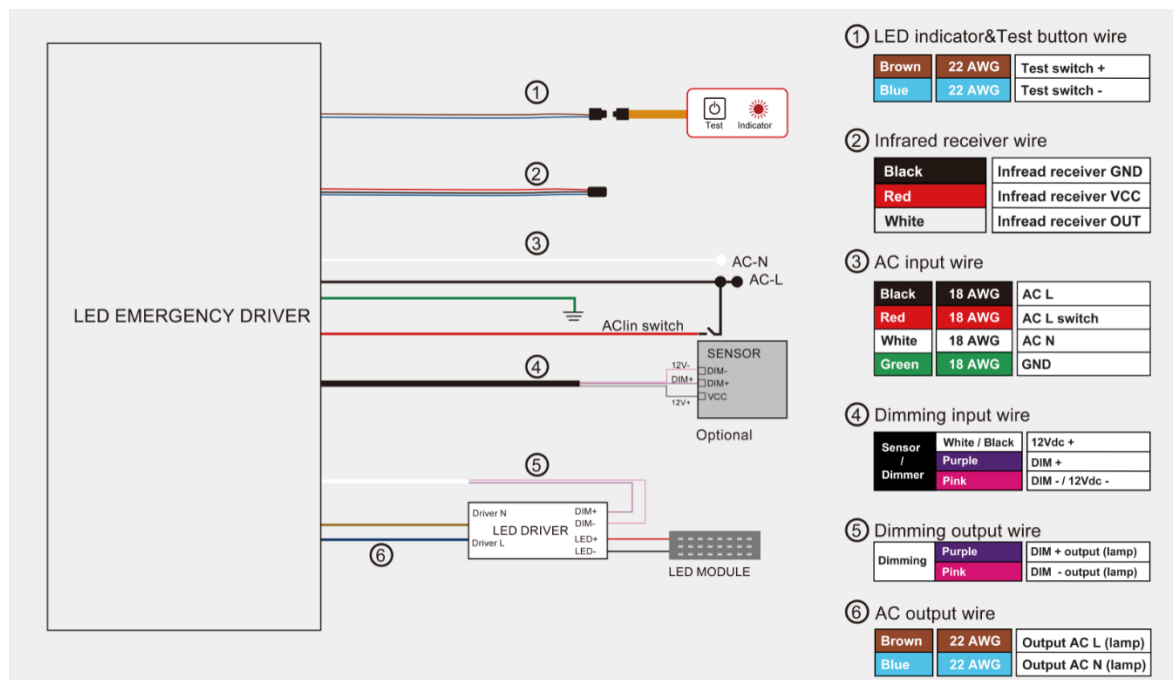

***Sensor and dimmer cannot be used at the same time**



Project Name: _____

Schedule / Date: _____

Notes: _____

PRODUCT AND CARTON DIMENSIONS


SIZE SKU	DIAGRAM	DIMENSIONS
2x4 53-202EM-XX		PRODUCT 47.76" x 23.74 x 1.38" 9.36 LBS 1 Pcs CARTON 49.40" x 25.59" x 2.96" 13.25 LBS 1 Pcs
2x2 53-201EM-XX		PRODUCT 23.74" x 23.74 x 1.38" 5.95 LBS 1 Pcs CARTON 25.40" x 25.60" x 2.96" 7.74 LBS 1 Pcs
1x4 53-203EM-XX		PRODUCT 47.76" x 11.93 x 1.38" 6.37 LBS 1 Pcs CARTON 48.82" x 13.78" x 5.91" 8.17 LBS 1 Pcs

PALLET & CONTAINER LOADING

SIZE SKU	WEIGHT	LENGTH	WIDTH	HEIGHT	40' HQ LOADING QTY.
2x2 53-201EM	643.68 LBS	50.79"	37.80"	81.10"	2160pcs
2x4 53-202EM	606.42 LBS	49.61"	37.80"	81.10"	1110pcs
1x4 53-203EM	648.32 LBS	49.61"	37.80"	78.60"	1044pcs


2' x 2'

144ctns/144pcs

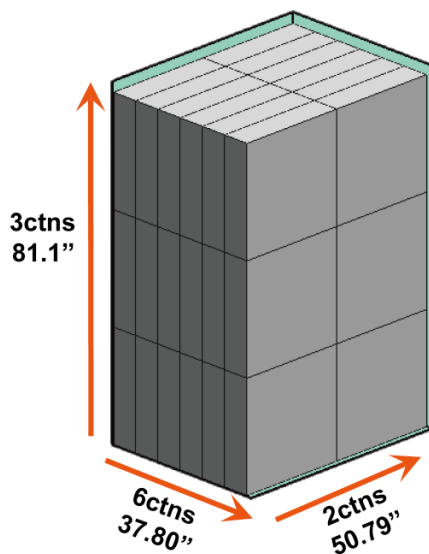


2' x 4'

72ctns/72pcs

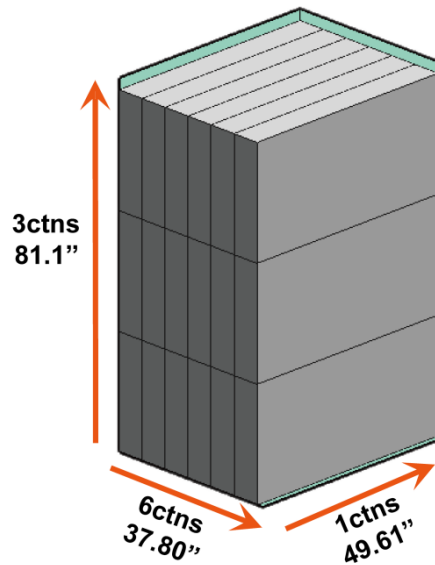

1' x 4'

128ctns/128pcs

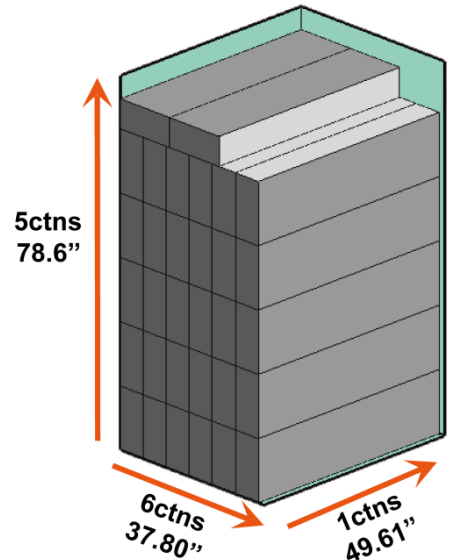

The above simulation diagram does not calculate the height and weight of the pallet, and the size and weight information will be slightly different from the actual situation.




Project Name: _____

Schedule / Date: _____

Notes: _____

ACCESSORIES

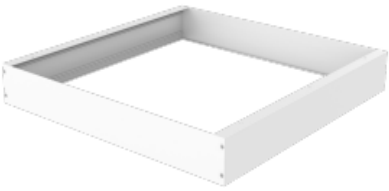SKU	DESCRIPTION	ITEM
39-2010S	AUX Sensor Daylight Bi-Level Standby	
78-20177-A	DC PnP Sensor Daylight Bi-Level Standby	
78-20178-A	Remote with display	
53-2089A	Hanging Cable Kit	
53-2091A	2x4' Surface Mount Kit	
53-2090A	2x2' Surface Mount Kit	
53-2092A	1x4' Surface Mount Kit	
53-2093A	Junction Box	
53-2094F	2x4' Flange kIT	
53-2093F	2x2' Flange kIT	
53-2095F	1x4' Flange kIT	

INSTALLATION INSTRUCTIONS

Safety Instruction:

Basic safety precautions should always be followed when installing, including the following:

1. Read instructions carefully before installing.
2. This LED Panel requires professional installation and maintenance.
3. The power supply of the LED Panel should be powered by a dedicated external LED driver.
4. Disconnect the power supply before installing or maintenance.
5. Make sure the wires have been properly connected before powering on the device.
6. Ensure the product has enough space for heat dissipation.
7. Ensure the luminaries are never covered by any heat insulation mat or slim layer material at anytime.
8. Suitable for damp locations.
9. Ambient Temperature: -20°C to + 45°C, Avoid direct sunlight.
10. Storage Conditions: Cool & dry conditions.
11. If you have any questions about our products, please contact us! Do not disassemble, repair or modify the product without permission!

Installation Procedure

⚡ WARNING:

1. Switch off before installation.
2. Switch on only after complete installation and examination of the circuit.




! CAUTION:

Make sure that the mounting surface or structural member used for installation can support the weight of LED Panel.

Wiring Diagram


Figure 1

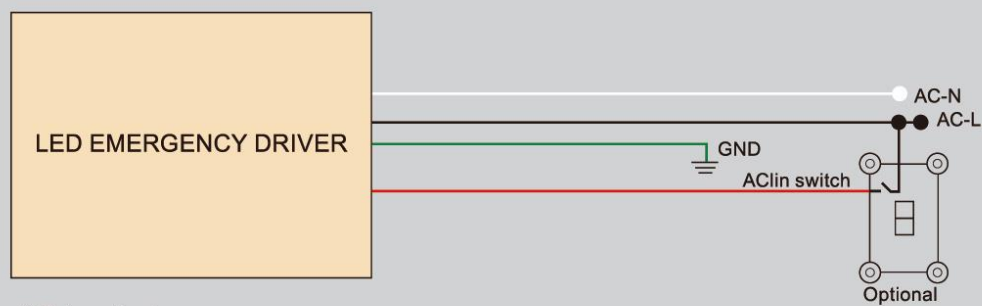


AC input wire

Wire color	
18AWG/Black	AC line (24/7)
18AWG/Red	AC line switch
18AWG/White	Neutra
18AWG/Green	GND 


⚠ Warning: Sensor and dimmer cannot be used at the same time!

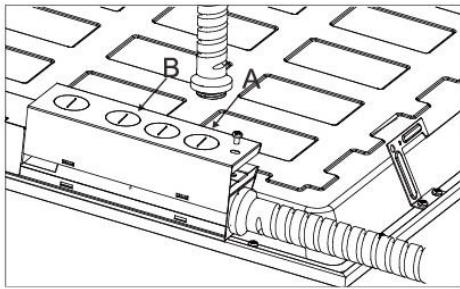

- (1) Remove the knock-down hole on box by screwdriver (Part A), Remove screw and take out the driver cover (Part B)

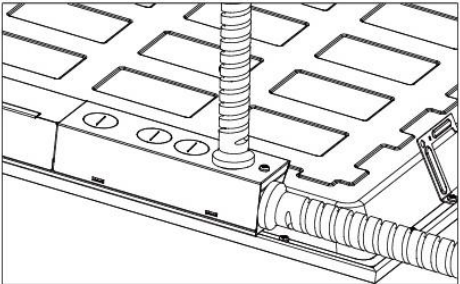


- (3) Cover the driver box and tighten it with a screwdriver, finish connection.





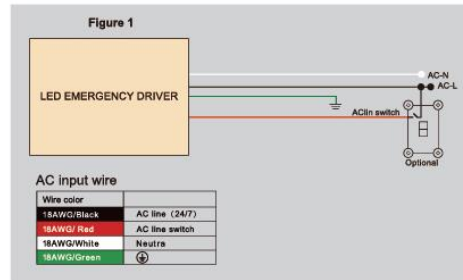


- (2) Connector the wires as Figure 1.

For the product with Slide Switch of CCT or power select please select the CCT or power needed before installati (Ignore these steps if without the function)

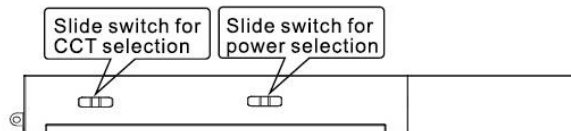

Surface mounted

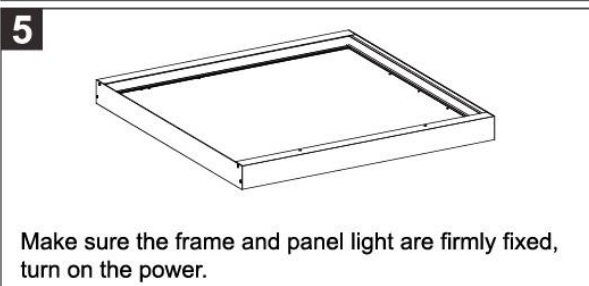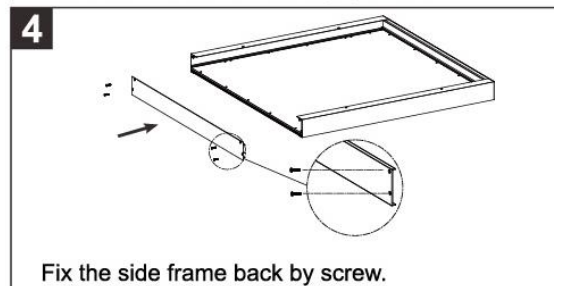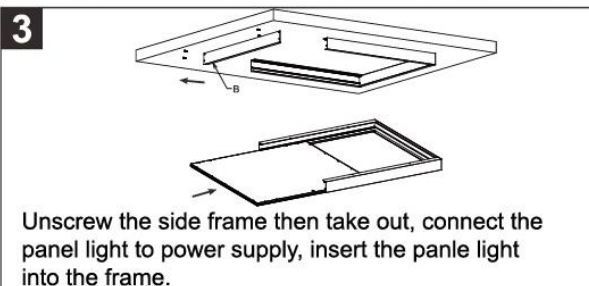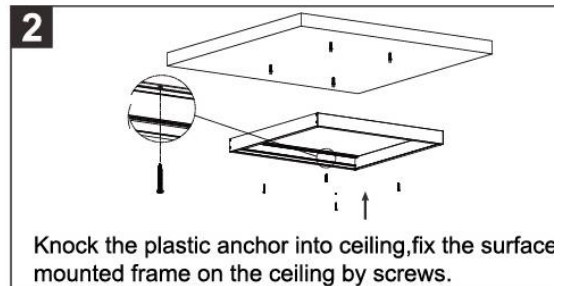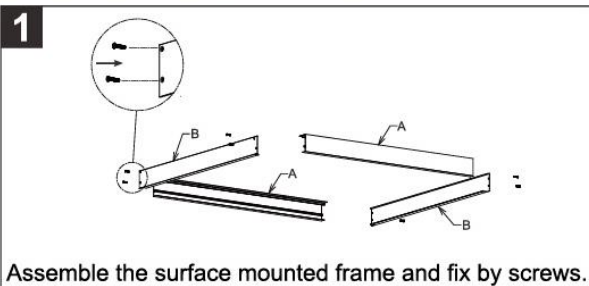

Recessed Mounting(Clips)

1

2

Cut Out Sizes		
Type	A(mm)	B(mm)
PL2X2	578	578
PL1X4	1188	278
PL2X4	1188	578

Clips can be purchased separately as an accessory.

Suspended

1

Fix the anchor into target place on the ceiling.

2

Fix the installation mount on the ceiling with plastic anchor.

3

Hang the panel to ceiling with suspended installation kits, adjust the length of steel wires.

4

Feed the main AC wire in driver terminal block respectively, turn on the power.

Recessed:

1

Remove the ceiling plaster slab.

2

Feed the main AC wire in driver terminal block respectively, connect the panel light and driver.

3

Fix the panel light into plaster ceiling.


4

Make sure the led panel light is firmly fixed, turn on the power.

Warning:


Input wire diameter $\geq 0.75\text{mm}^2$;
Product modification and improper installation are not valid for warranty!

Audio jack PIR sensor

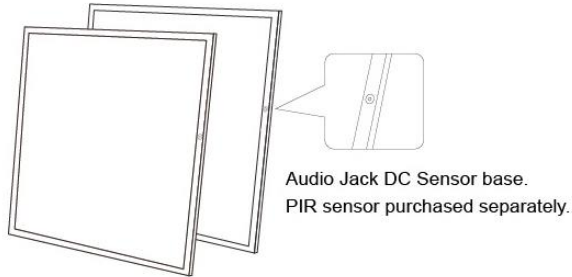


Built-in motion sensor

1



The cover plate on the back is reserved for the back wiring installation of DC sensor.


2

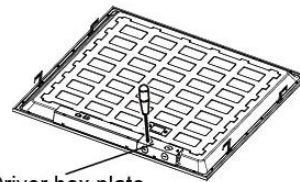

Driver box plate


If the user needs to install the sensor, the sensor cover and driver box plate should be removed first.

3

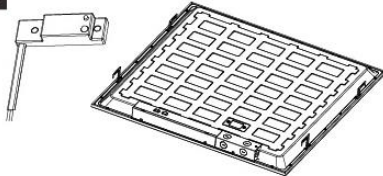

Before installing the sensor, connect the terminal wire of the sensor with the terminal wire of driver output. Then aim the sensor at the hole of the sensor and put it on the back plate.

4

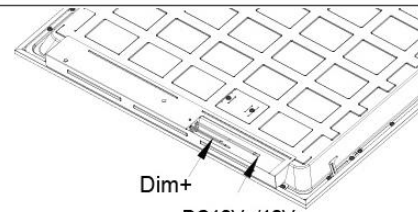

Dim+
DC12V+/12V-

Sensor Dim+(purple)
Sensor Dim-(yellow)
Sensor DC12V+(red)